


# PRODUCT DATA SHEET

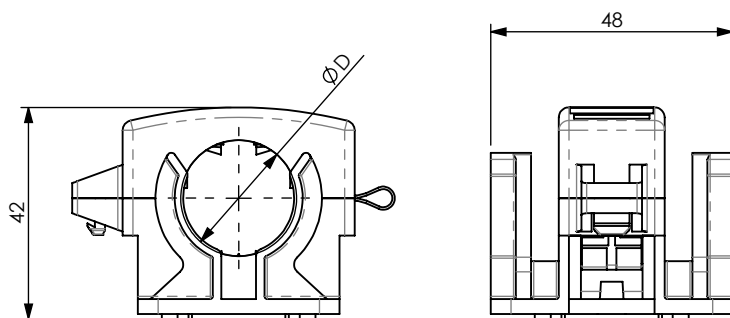

## A) SPECIFICATIONS

Cable clamp. Material: P.A.6 UL94-V0  
Self Extinguishing, black colour,  
halogen free (according to UL94-V0).  
1) Elastic provisional pre-fixing of cable.  
2) Security locking system.

## B) OPERATING TEMPERATURE


Working temperature :  $-40^{\circ}\text{C} + 125^{\circ}\text{C}$ .  
Installation temperature :  $-20^{\circ}\text{C} + 60^{\circ}\text{C}$ .

## C) DELIVERY MODALITIES

Packing in boxes. Label indicating:  
product code, article, quantity,  
production batch, FIMO logo and figure.  
( Customer code on request ).

## D) MOUNTING INSTRUCTIONS

RAC IST 021 REV2

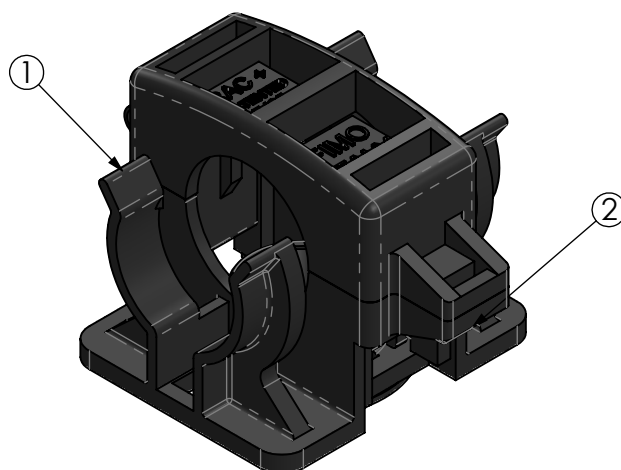

|         |                   |
|---------|-------------------|
| code    | <b>6150000058</b> |
| article | RAC+ 5/8"         |

|          |                                                                                       |                                                                                       |
|----------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|
| <b>D</b> |  |  |
| 20-23    | 50                                                                                    | 0.0246kg                                                                              |

| RI                                                                                  | DATE       | DR   | DATE       | AP                                                                                  | <i>Description:</i><br><br><b>RAC+ 5/8"</b><br><b>Radiating Cable Clamps</b> |
|-------------------------------------------------------------------------------------|------------|------|------------|-------------------------------------------------------------------------------------|------------------------------------------------------------------------------|
| 02                                                                                  |            |      |            |                                                                                     |                                                                              |
| 01                                                                                  |            |      |            |                                                                                     |                                                                              |
| 00                                                                                  | 06/12/2016 | E.B. | 06/12/2016 | A.V.                                                                                |                                                                              |
| 1 <sup>ST</sup> EMISSION                                                            |            |      |            |                                                                                     |                                                                              |
|  |            |      |            |  | <i>Use: Installation of radiating cables in tunnel</i>                       |